
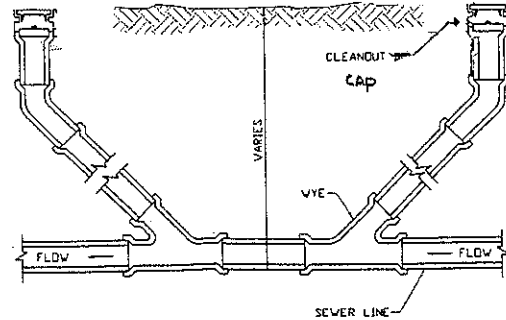



GREATER RAMSEY WATER DISTRICT

Septic Tank Hookup Details

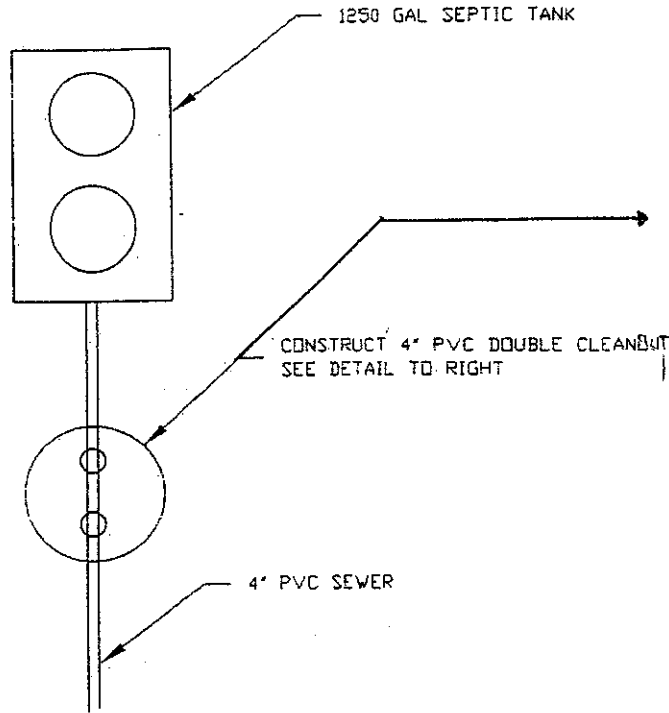

Double Cleanout Detail

Septic Tank Detail

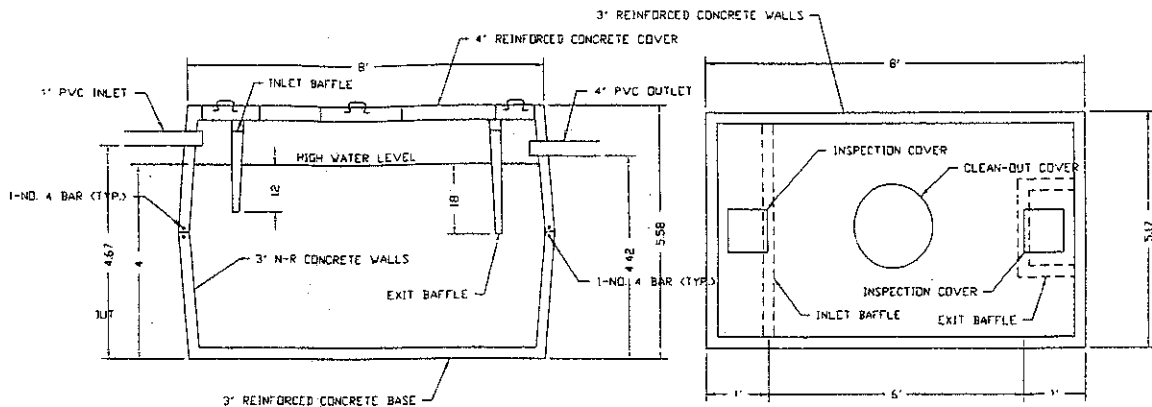

The double cleanout assembly shall be installed within 3 feet of the outlet of the tank. The cap must be visible or be buried with a piece of metal within 3" of the ground surface

The 12" cover for the septic tank must be ground level. Use 12" pvc provided by the tank supplier to extend the cover to the planned ground elevation.

The tank must be placed in a location which GRWD can maintain the tank. This includes pumping which is done with a large truck which must be able to drive within a maximum of 40 feet of the tank for proper pumping.